DITEC barrier Layout		
Type	----	
Motor Location	Boom Length	Qty.
---	--	--

Power/Electrical Requirement	
Phase	1 Φ
Voltage	230 V
Frequency	50 HZ
Current	Max. 5 Amp.

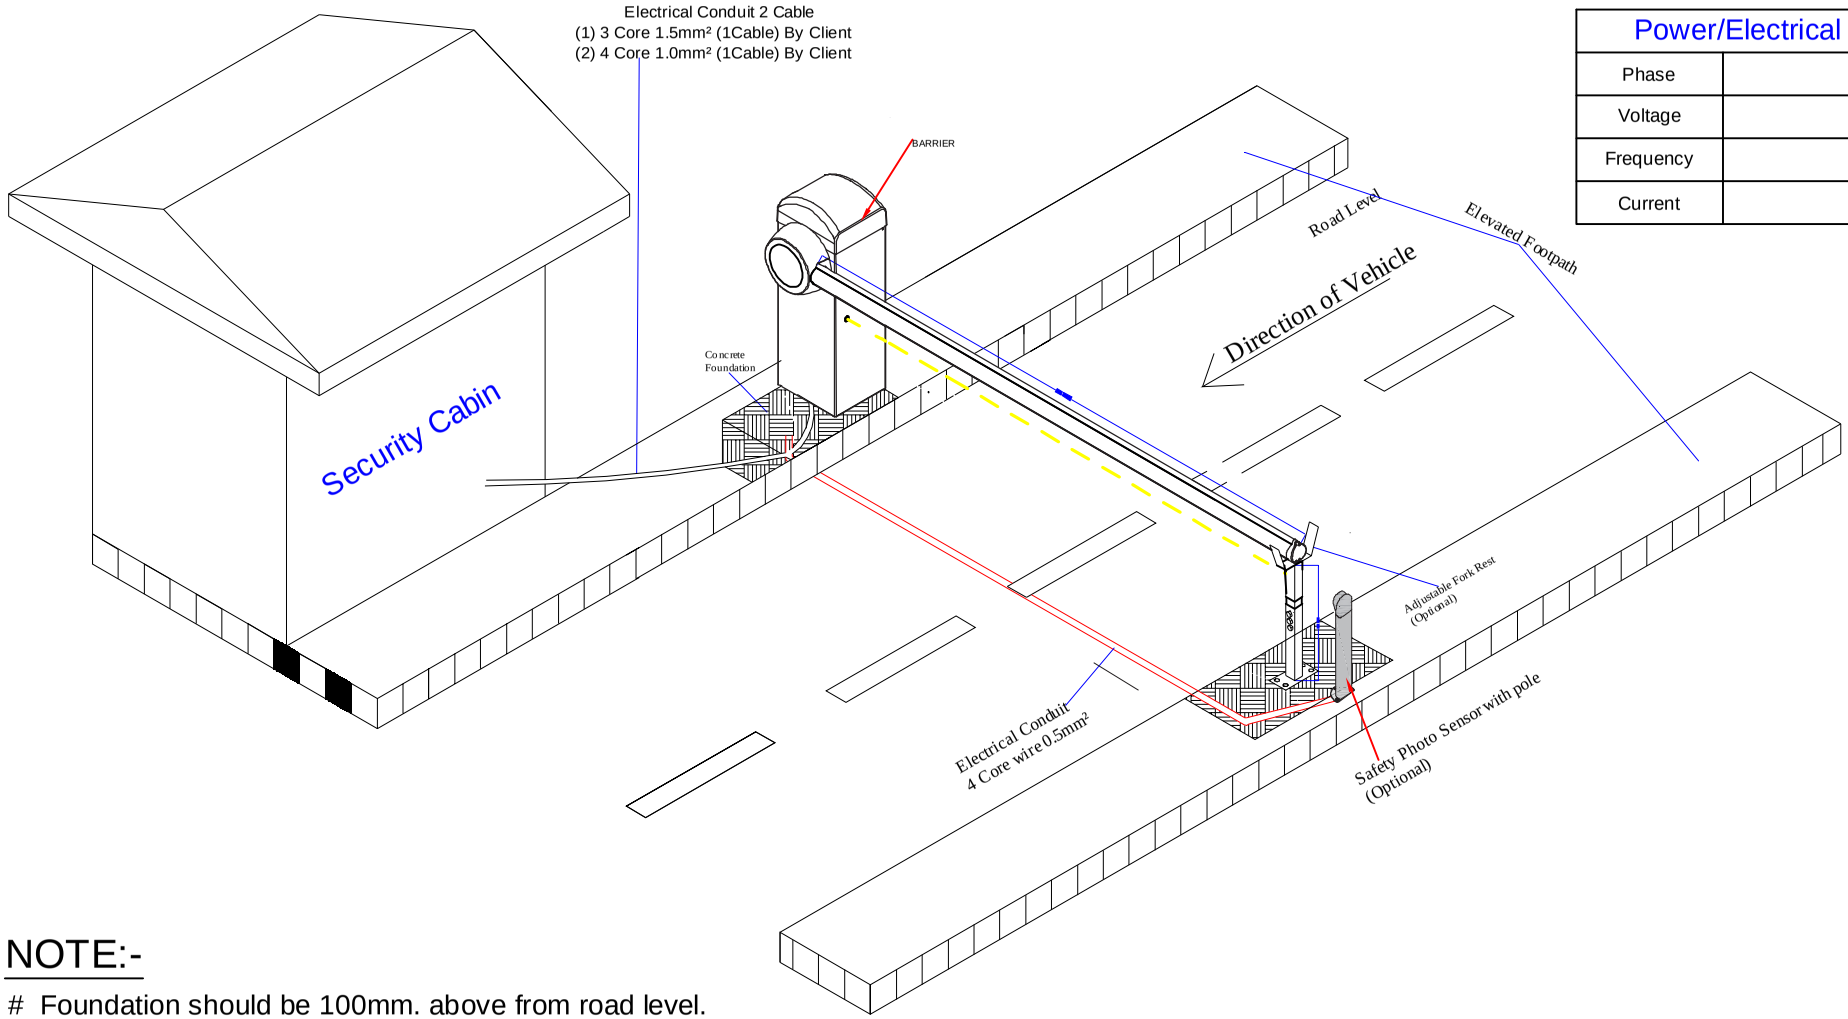

NOTE:-

Foundation should be 100mm. above from road level.
All cables & electrical conduit tray to be provided by OTHERS.
All civil work by client.

SCALE-NTS	GROUP :- Automatic Boom Barriers				PRODUCT :- Automatic Boom Barrier		MODEL NO:- Ditec Set-Qik 4E	
This drawing is the soul property of (TAS) Do not copy/reproduce /share with others without our permission.	REV	DATE	DESCRIPTION	DRAWN BY	APPROVED BY	DATE	DRAWN BY	CHECKED BY	APPROVED BY
	00	03-10-18	ISSUED FOR APPROVAL	SOHRAB KHAN	MOHD.AMIL	03-10-18	SOHRAB KHAN	MOHD.AMIL	KAPIL SACHDEV
						PRO NO:- 5431	DRAWING NO :- GA-357 (PRO5431) Ditec Set-Qik 4E		

toshi
Automation Solutions